

Ciaran O'Rafferty
 Barrett Mahony Consulting Engineers
 52-54 Sandwith St. Lower
 Dublin 2
 D02WR26

Uisce Éireann
 Bosca OP 448
 Oifig Sheachadta na
 Cathrach Theas
 Cathair Chorcaí

Irish Water
 PO Box 448,
 South City
 Delivery Office
 Cork City

www.water.ie

11 May 2022

Re: CDS22003138 pre-connection enquiry - Subject to contract | Contract denied

Connection for Multi/Mixed Use Development of 347 units at 326-328, South Circular Road, Dublin


Dear Sir/Madam,

Irish Water has reviewed your pre-connection enquiry in relation to a Water & Wastewater connection at 326-328, South Circular Road, Dublin (the **Premises**). Based upon the details you have provided with your pre-connection enquiry and on our desk top analysis of the capacity currently available in the Irish Water network(s) as assessed by Irish Water, we wish to advise you that your proposed connection to the Irish Water network(s) can be facilitated at this moment in time.

SERVICE	<p style="text-align: center;">OUTCOME OF PRE-CONNECTION ENQUIRY</p> <p style="text-align: center;"><u>THIS IS NOT A CONNECTION OFFER. YOU MUST APPLY FOR A CONNECTION(S) TO THE IRISH WATER NETWORK(S) IF YOU WISH TO PROCEED.</u></p>
Water Connection	Feasible without infrastructure upgrade by Irish Water
Wastewater Connection	Feasible without infrastructure upgrade by Irish Water
SITE SPECIFIC COMMENTS	
Water Connection	The proposed Development indicates that Irish Water assets are present on the site. The Developer has to demonstrate that proposed structures and works will not inhibit access for maintenance or endanger structural or functional integrity of the assets during and after the works. Drawings (showing clearance distances, changing to ground levels) and Method

	<p>Statements should be included in the Detailed Design of the Development. A wayleave in favour of Irish Water will be required over the assets that are not located within the Public Space. For design submissions and queries related to diversion/build near or over, please contact IW Diversion Team via email address diversions@water.ie</p>
Wastewater Connection	<p>Removal of storm water in the existing combined network to facilitate the provision of capacity will be required. Minimum reduction should be at a ratio of 3 SW:1 WW-peak for design flow 1 in 1-year event. Further information, verified by surveys, should be provided at a connection application stage and before any existing infrastructure is demolished, regarding the current storm connection.</p> <p>Separate storm and foul water connection services should be provided for the Development. Storm water from the site must be discharged only into the existing storm water network or associated alternative to a combined drainage discharge. The connection arrangement should be agreed with Dublin City County Council Drainage Division.</p> <p>Proposed basement car park should be designed such that surface water from the site and/or surrounding areas cannot flow down to the car park. Wastewater from the car park (contaminated water generated from run off from cars/tyres) must be pumped to ground level to discharge by gravity to the Irish Water Network via a petrol interceptor.</p> <p>The proposed Development indicates that Irish Water assets are present on the site. The Developer has to demonstrate that proposed structures and works will not inhibit access for maintenance or endanger structural or functional integrity of the assets during and after the works. Drawings (showing clearance distances, changing to ground levels) and Method Statements should be included in the Detailed Design of the Development. A wayleave in favour of Irish Water will be required over the assets that are not located within the Public Space. For design submissions and queries related to diversion/build near or over, please contact IW Diversion Team via email address diversions@water.ie</p>
<p>The design and construction of the Water & Wastewater pipes and related infrastructure to be installed in this development shall comply with the Irish Water Connections and Developer Services Standard Details and Codes of Practice that are available on the Irish Water website. Irish Water reserves the right to supplement these requirements with Codes of Practice and these will be issued with the connection agreement.</p>	

The map included below outlines the current Irish Water infrastructure adjacent to your site:

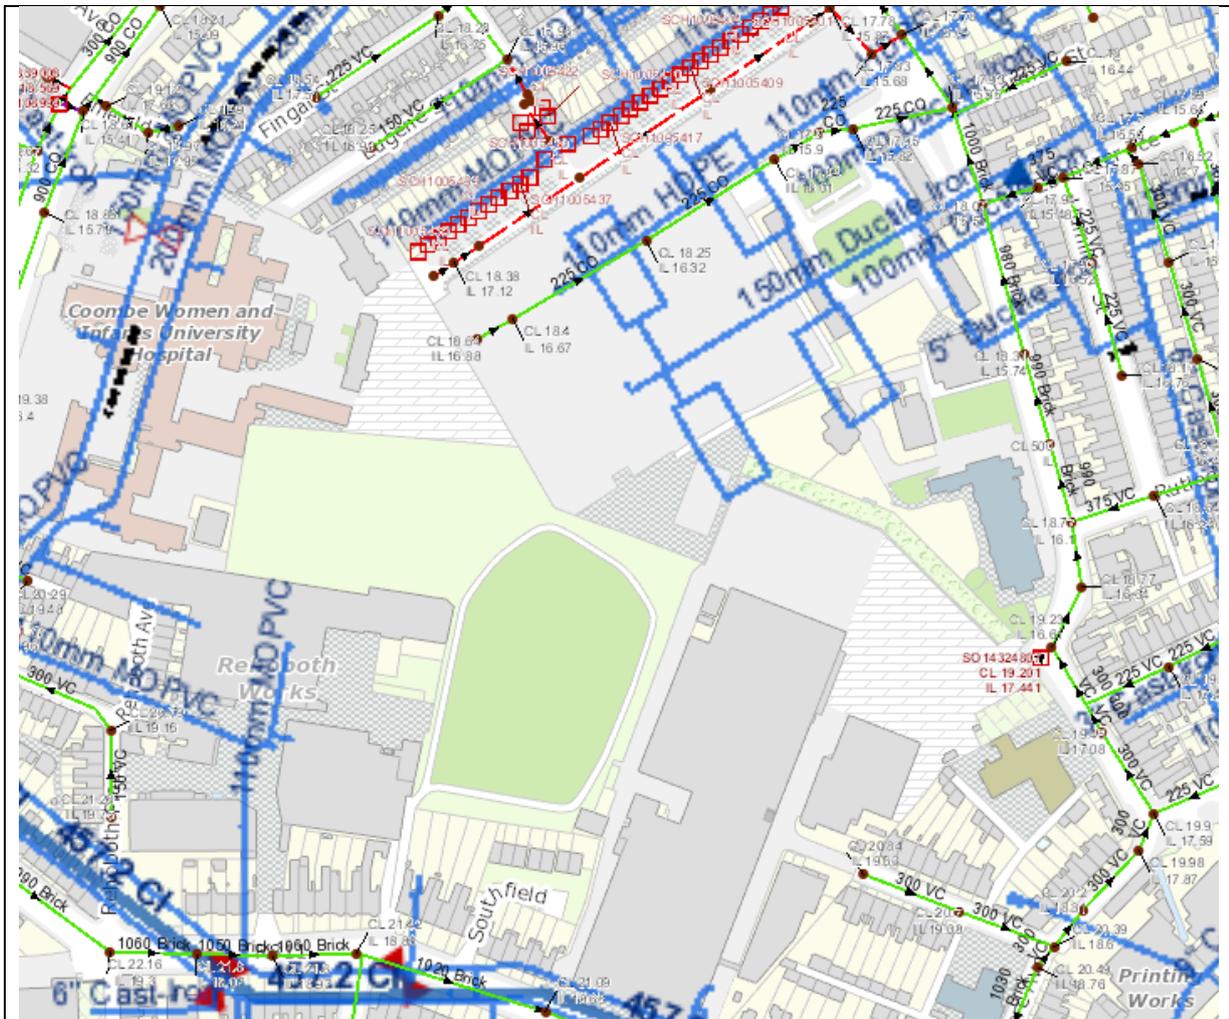

Reproduced from the Ordnance Survey of Ireland by Permission of the Government. License No. 3-3-34

Whilst every care has been taken in its compilation Irish Water gives this information as to the position of its underground network as a general guide only on the strict understanding that it is based on the best available information provided by each Local Authority in Ireland to Irish Water. Irish Water can assume no responsibility for and give no guarantees, undertakings or warranties concerning the accuracy, completeness or up to date nature of the information provided and does not accept any liability whatsoever arising from any errors or omissions. This information should not be relied upon in the event of excavations or any other works being carried out in the vicinity of the Irish Water underground network. The onus is on the parties carrying out excavations or any other works to ensure the exact location of the Irish Water underground network is identified prior to excavations or any other works being carried out. Service connection pipes are not generally shown but their presence should be anticipated.


General Notes:

- 1) The initial assessment referred to above is carried out taking into account water demand and wastewater discharge volumes and infrastructure details on the date of the assessment. **The availability of capacity may change at any date after this assessment.**

- 2) This feedback does not constitute a contract in whole or in part to provide a connection to any Irish Water infrastructure. All feasibility assessments are subject to the constraints of the Irish Water Capital Investment Plan.
- 3) The feedback provided is subject to a Connection Agreement/contract being signed at a later date.
- 4) A Connection Agreement will be required to commencing the connection works associated with the enquiry this can be applied for at <https://www.water.ie/connections/get-connected/>
- 5) A Connection Agreement cannot be issued until all statutory approvals are successfully in place.
- 6) Irish Water Connection Policy/ Charges can be found at <https://www.water.ie/connections/information/connection-charges/>
- 7) Please note the Confirmation of Feasibility does not extend to your fire flow requirements.
- 8) Irish Water is not responsible for the management or disposal of storm water or ground waters. You are advised to contact the relevant Local Authority to discuss the management or disposal of proposed storm water or ground water discharges
- 9) To access Irish Water Maps email datarequests@water.ie
- 10) All works to the Irish Water infrastructure, including works in the Public Space, shall have to be carried out by Irish Water.

If you have any further questions, please contact Marina Byrne from the design team via email mzbyrne@water.ie For further information, visit www.water.ie/connections.

Yours sincerely,



Yvonne Harris

Head of Customer Operations